Loop-Powered AC Current Transmitter

DIN RAIL / PANEL MOUNT, AVERAGE RMS



Single Element - .79" Window 0.5 to 50 AAC Input Range



Two Element - .26" Window 0.5 to 30 AAC Input Range

The **CR4200** Series, Current Transmitters produce a calibrated 4-20 mADC signal that is proportional to the average RMS input AC current. Designed for multi-point current sensing, these devices provide excellent features in a value package. The output signal is generated from a user supplied 24 VDC power supply within the output current loop.

Applications

Multi-point current sensing and control panels Remote current sensing Monitor motor faults Monitor heating elements Monitor lighting elements

Features

Relatively low cost 35mm DIN rail or panel mount High Accuracy Easy wiring Interfaces with most commercially available instrumentation Connection diagram printed on case

Regulatory Agencies

Recognized to meet UL 61010B-1 Constructed to meet CAN/CSA-C22.2, No. 61010-1-2004 Meets requirement of IEC 61010-1 and BS EN 61010-1







E199795

CR Magnetics has a wide selection of current transformers to extend the range of any part. Contact factory for more information.



All single phase current transducers are available in split core design. Simply put an "S" at the end of the prefix* I.E. CR4220S-10 * Not UL Recognized

| PART NUMBERS | | | | | |
|--------------|---|--|--|--|--|
| CR4220(S) | • | | Single element with 4 - 20 mADC output (split core design) | | |
| CR4260 | - | | Two element with 4 - 20 mADC output* | | |

Add suffix for input range

| 5 | - | 0-5 AAC |
|----|---|----------|
| 10 | - | 0-10 AAC |
| 15 | - | 0-15 AAC |
| 20 | - | 0-20 AAC |
| 25 | - | 0-25 AAC |
| 30 | - | 0-30 AAC |
| 40 | - | 0-40 AAC |
| 50 | - | 0-50 AAC |

Ranges available up to and including 600 AAC

Sweek www.isweek.com

Add: 16/F, Bldg. #3, Zhongke Mansion, No.1 Hi-Tech S. Rd, Hi-Tech Park South, Shenzhen, Guangdong, 518067 P.R.ChinaTel: + 86-755-83289036Fax: + 86-755-83289052E-mail: sales@isweek.com

Sweek.com


Loop-Powered AC Current Transmitter

DIN RAIL / PANEL MOUNT, AVERAGE RMS

SPECIFICATIONS

| Basic Accuracy: Linearity: Thermal Drift: Operating Temperature: Installation Category: Vibration Tested To: Pollution Degree: Insulation Voltage: Altitude: | 500 PPM/°C 0°C to +60°C CAT II EC 60068-2-6,1995 2 |
|--|--|
| - | |
| | |
| Frequency Range: Calibration:Average Sensir | |

| MTBF: | Greater than 100 K |
|---------------------|---------------------------|
| HoursCleaning: | Water-dampened cloth |
| Output Load: | 0 to 300 Ω |
| Response Time: | 250 ms max., 0-90%FS |
| Relative Humidity: | 5% to 95%, Non-Condensing |
| Supply Power: | Loop Voltage 24 Vdc |
| Compliance Voltage: | 16 to 28 Vdc |
| Torque Specs.: | 3.0 inch lbs. (0.4Nm) |
| Weight: | 0.5 lbs. |
| | |

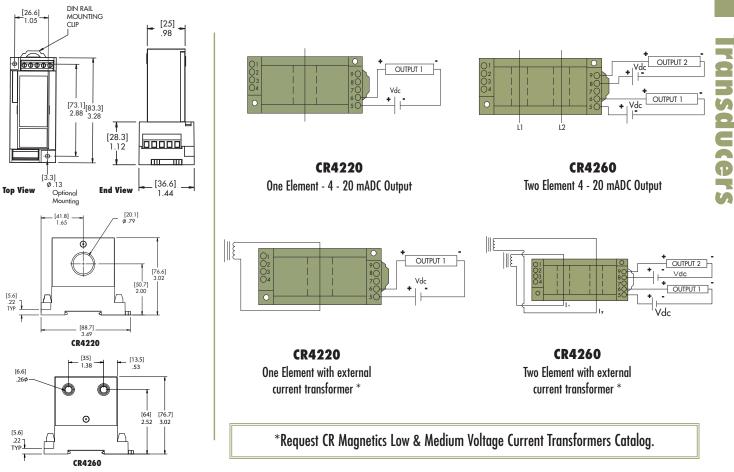

OUTLINE DRAWING

CONNECTION DIAGRAM

NOTE: The building installation must have a switch or circuit-breaker that is in close proximity and within easy reach of the operator. The switch or circuit breaker shall be marked as the disconnecting device for the equipment.

